

# Power Prowler™

## USER MANUAL

3-In-1 DMM/TDR Cable Fault Finder for  
Energized and Unenergized Cables



**PLR600**

# **Power Prowler™**

## **3-In-1 DMM/TDR Cable Fault Finder for Energized and Unenergized Cables**

### **User Manual**

### **Table of Contents**

About the Power Prowler.....	3
Features and Functions.....	3
Physical Features.....	3
Optional Accessories.....	4
Safety Information.....	5
Power Prowler Description.....	6
Terms and Descriptions.....	7
Types of Faults.....	7
General Operations.....	8
On/Off.....	8
Automatic Power Down.....	8
System Settings.....	9
Digital Multimeter Options (DMM).....	11
Fault Location (TDR Operation).....	14
To Begin Test for Fault Location.....	14
Fault Location Display.....	15
Functions.....	15
Changing VOP Values.....	16
Calibrating VOP Values.....	16
Favorites.....	18
Conducting a Test.....	19
Live Event Detection.....	20
Run a Live Event Detection Test.....	20
Maintenance.....	21
Batteries.....	21
Cleaning.....	21
Storage.....	21
Customer Service.....	22
Specifications.....	23
Patents/Intellectual Property.....	25
Warranty Information.....	26
Registration.....	26
Disposal.....	26
Returns.....	26

## ABOUT THE POWER PROWLER

The Power Prowler is used to accurately measure voltage and resistance as well as to test voice, data, and video cables. The Power Prowler determines cable length, identifies cable faults, and quickly discovers the Velocity of Propagation (VOP) for a cable using patented Spread Spectrum Time Domain Reflectometry (SSTDR).

<b>Feature</b>	<b>Function</b>
Works on both energized and unenergized cables	Discover cable events, including those which can only be shown under load
Digital Multimeter	Prowler measures DC voltage, AC voltage, continuity, and resistance
Fault Location	Quick picture of existing cable faults and condition
Displays length reading in feet or meters	International applications
Live Event Detection	Monitors the cable for events (faults)

### Physical Features

<b>Feature</b>	<b>Function</b>
Large color LCD display	Easy to see in all lighting environments
Compact form factor	Usable in tight spaces
Bench top, handheld, or hung up	Easy to use for field flight line and production work
Banana style interface	Connects to many types of systems
Uses 6 AA batteries (included)	Provides power for 20 to 30 hours
Multilingual	English, French, or Spanish

## Power Prowler

Your Power Prowler is part of a kit. Optional accessories are also available.




---

<b>PLR600</b>	<ul style="list-style-type: none"><li>▪ Power Prowler Main Unit</li><li>▪ DMM Meter Leads 600V CAT III</li><li>▪ Leader Cable: 5 feet 600V CAT III</li><li>▪ Flanged Crocodile Clips: red and black 600V CAT III</li><li>▪ BNC (F) to Double Banana Plug</li><li>▪ BNC (M) to F Connection (F)</li><li>▪ Hanging T3 Pouch</li></ul>
<b>Optional</b>	<ul style="list-style-type: none"><li>▪ BNC (M) to Alligator Clips (CA002)</li><li>▪ Multi-pin Adapter 1000V CAT III (AD006)</li><li>▪ Cable Assembly, Power Cord to 3 Banana Plugs 300V (CA009)</li></ul>

---

## Safety Information

To ensure safe operations of the Power Prowler, follow instructions carefully and observe warning and caution messages in this manual. Failure to observe warnings can result in severe injury or death and can damage the equipment.

Notification	Definition
	<b>Warning:</b> Potential for personal injury. <b>Caution:</b> Potential for damage to or destruction of equipment.
<b>Voltage!</b>	Voltage detection: Voltage on cable is unsafe or exceeds safety maximums.
	Conformité Européenne. Conforms to European Economic Area directives.
	Disposal information

- Do not use the Power Prowler or Power Prowler accessories if they appear damaged or the unit is not working properly.
- Do not use with voltages higher than the Power Prowler's rated voltage (600V).
- Use with caution with voltages greater than 30V AC RMS, 42V AC peak, or 60V DC.
- Disconnect circuit power and discharge high-voltage capacitors when testing capacitance, continuity, diodes, or resistance.
- Do not use around explosive or flammable gas.
- Use only test leads approved by a safety agency that have the same voltage, amperage, and category as the Power Prowler.
- Before opening the battery door, remove leader cables.
- Always wear personal protective equipment when working with the Power Prowler.
- Use caution when handling the probes and cable connections on the Power Prowler when the Voltage! icon is present.

# Power Prowler Description

**On the LCD screen, three main functions are displayed**

## 1. Multimeter

## 2. Fault Detection

Warning LEDs

Battery life

LCD display screen

## 3. Live Event Detection

Keypad

Function keys

Multimeter

Settings

Fault Location

Live Event Detection Test

Back  
(to previous screen)

Enter

Left/right arrows

Up/down arrows

Power On/Off

The four soft keys below the screen operate each of the four functions on the screen (just above each key). The following graphics appear only in home screen mode:



Banana jack connectors

## Terms and Descriptions

Table 1 defines the terms used throughout the document and provides information to assist with proper operation and understanding of the unit and its functions.

**Table 1.** Terms and Descriptions

<b>Terms</b>	<b>Description and Uses</b>
Velocity of Propagation (VOP)	Speed of electric signal traveling through a cable; measured as a percentage of speed of light
Safety Extra Low Voltage (SELV)	International Electrotechnical Commission rating; defines safe voltage standards of electronic devices (60 volts DC or Peak AC; 45 volts RMS)
Spread Spectrum Time Domain Reflectometry (SSTDR)	Spread Spectrum Time Domain Reflectometry (SSTDR) is a measurement technique to identify faults, usually in electrical wires, by observing reflected spread spectrum signals.

## Types of Faults

Table 2 defines two possible error conditions on a cable; Short and Open. All detected cable faults will appear on the test results screen of the Power Prowler.


**Table 2.** Types of Faults

<b>Terms</b>	<b>Description and Uses</b>
Open	Wire connection is not continuous throughout cable length
Short	Two or more wires in a cable are connected (short circuit)


## GENERAL OPERATIONS

Follow instructions carefully and pay attention to warning and caution symbols. Failure to observe warnings can result in damage to the Power Prowler or cause severe injury or death.

### On/Off



- Turn unit on/off—press the red **Power** button .


### Automatic Power Down









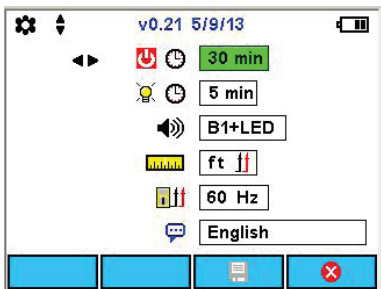





- The Power Prowler automatically dims the backlight and powers off to conserve battery power if no input or activity is performed on the device. Press the **Setup** soft key  to adjust the length of time before the LCD screen dims and power off timeout.








## SYSTEM SETTINGS


A setting is selected by pressing the up and down arrow keys. The currently selected setting is indicated by the left and right arrow icons appearing beside the function and the value of the function being highlighted with a green background. Use the left and right arrows to change the settings. To save any settings changed, press the **Save** soft key  or to exit without saving, press the **Cancel** soft key .



- Automatic Power Off   – Automatic power off is adjustable between 5 and 30 minutes in 1 minute increments.
- Backlight Dimming   – The dimming of the backlight to save power can be set between 1 and 9 minutes in 1 minute increments. Pressing a key restores the backlight to full brightness.
- Audio/Visual Alerts  – The alert signal is used by the DMM continuity mode to indicate a low resistance. Various combinations of the buzzer and LED are available – low frequency buzzer (B1), high frequency buzzer (B2), B1 plus the alert LED (B1+LED), B2 plus the alert LED (B2+LED) or LED only (LED). An example of the alert is activated when selecting a different alert setting.
- Feet/Meters and Leader Cable  - The length units and leader cable settings are selected by this function to either:
  - Feet with no leader cable  
  - Feet with a 5 foot leader cable  
  - Meter with no leader cable  
  - Meters with a 5 foot leader cable  




- Power Line Frequency (DMM)  - Use the **Left/Right** buttons to toggle between 50 and 60Hz power line frequencies. Set to the local line frequency to reduce noise sensitivity to power lines.
- Language  – English is the default language selected. Use the left and right arrow keys to select either English, French, or Spanish.
- Saving changes - Once the settings have been adjusted to the user's satisfaction, press the **Save** button  to save the settings.
- To cancel your settings: Either press **Cancel** at any time and return to the previous screen , or by pressing the **Back** button .
- Back button always returns to the previous screen whether it is the home screen or one of the test modes.
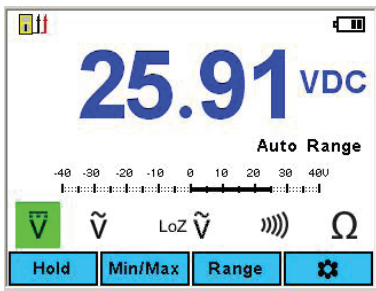
## DIGITAL MULTIMETER OPERATIONS (DMM)



The Digital Multimeter Mode of the Power Prowler measures DC voltage, AC voltage, continuity, and resistance. For voltage and resistance, the Power Prowler will provide a measurement as well as minimum and maximum values.


### Using the Multimeter

- Press the red **Power** button  to turn the unit on.
- Connect the appropriate adapter(s) for your application to the Power Prowler, and then connect to the cable under test.
- Select the Multimeter icon by pressing the **Left/Right** buttons, then press the **Enter** button  or press the **DMM** soft key .
- Using the **Left/Right** buttons, cycle through the DMM functions to read each measurement [Direct Current (DC) Voltage, Alternating Current (AC), Low Impedance Alternating Current (LoZ AC), Continuity, and Resistance (Ohms)].
  - DC mode  $\overline{V}$  measures direct current input voltage.
  - AC mode  $\tilde{V}$  measures the RMS (root mean square) value of alternating current voltage.
  - LoZ AC or Low Impedance AC Mode  $LoZ \tilde{V}$  sets input impedance to about 1,000 Ohms and measures the RMS value of alternating current voltages. This reduces the chances of false readings due to probes picking up AC voltage before they are connected to the test circuit.
  - Continuity Mode  $\text{)))}$  identifies continuity by measuring the resistance between input probes and displays either OL (overload) for

an open circuit or Low Resistance (LO). Maximum resistance to detect continuity is 250 Ohms.

- Resistance Mode  $\Omega$  measures and displays resistance between input probes.

The display shows real-time input unless you press Hold or Min/Max.



When input exceeds your presently selected range, the letters OL (overload) appear. When your input is out of range or over 60V (AC or DC), the high voltage warning sign  appears, alerting you to a potentially hazardous voltage.

All DMM modes display a bar graph that approximates the percent of the full range of the function selected.


### Common Voltage Mode Functions

The following common voltage mode functions are used when DC Voltage, AC Voltage, or Low Impedance have been selected (see above).


- Hold (freezes display at current measurement)
  - Press the **Hold** soft key to freeze the display. The word Hold appears in red on the screen.
  - Press the **Hold** soft key to resume real time measurement.
- Range (manually select a **Range** or use the automatic range Auto Range). The range is displayed to the lower right of the measurement.
  - Press the **Range** soft key repeatedly to cycle through Manual Range options or Auto Range.
  - Auto Range is the default. Ranges available are: 0-4V, 0-40V, 0-400V, and 0-600V.
- Min/Max (displays maximum and minimum values, as well as average value)
  - Once range and the desired voltage measurements have been selected, press the **Min/Max** soft key to display minimum/maximums. If a new high or low measurement is encountered, the Min/Max display changes.
  - To display an average measurement, press the **Average** soft key (which changes to Min/Max). An average value will be displayed and change according to continuing real-time input.
  - Press the **Hold** soft key to freeze the display. The word HOLD will appear on the screen in red.

- Press the **Hold** soft key to resume real-time displays.
  - Press the **Restart** soft key to reset the AVG and VDC or VAC readings and display new inputs.
  - Press the **Min/Max** soft key to switch back to the Min/Max mode.
  - Pressing the **Restart** soft key will restart the accumulation of Max/Min readings in the Min/Max mode.
  - Press the **Back** button  to exit Min/Max and return to the normal voltage display screen.
- 
- Press the **Back** button  to exit the current DMM function and return to the home screen.

## FAULT LOCATION (SSTDR OPERATION)

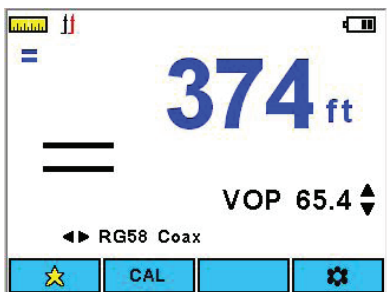





The Power Prowler determines the length of a variety of cable types and calculates the VOP of a cable with known length.

When connecting to a cable, use proper adapters for the application. When connecting to energized cables over 60V, you will need the leader cable (CA008) rated at 600V CAT III. If a leader cable is being used, the **leader installed** option  should be selected for a more accurate length reading. See Setting Options for more information on leader settings (page 9).








*Internal Power Prowler components are protected to 600V peak AC or DC. Connecting the unit to cabling with voltages above 600V peak AC or DC may damage the unit and pose a safety hazard for the user.*

### To Begin a Fault Location Test

- Press the red **Power** button  to turn the unit on.
- Connect the proper adapter for your application to the Power Prowler, and then connect to the cable under test. Select the Fault Location icon by pressing the **Left/Right** buttons, then press the **Enter** button  or press the **Fault Location** soft key .
- Use the **Left/Right** buttons to scroll to the cable type being tested. The cable type appears on the bottom of the screen.
- Press the **Test** button  to measure the length of the cable or the distance to a fault.





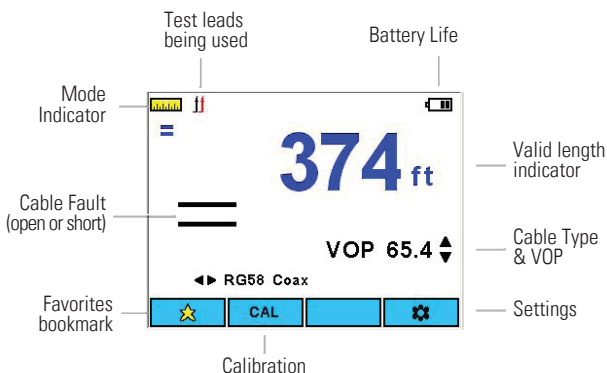

## Fault Location Display

- Press the red **Power** button  to turn the unit on.
- Connect the proper adapter for your application to the Power Prowler, and then connect to the cable under test. Select the Fault Location icon by pressing the **Left/Right** buttons, then press the **Enter** button  or press the Fault Location soft key .
- Use the **Left/Right** buttons to scroll to the cable type being tested. The cable type appears on the bottom of the screen.
- Press the **Test** button  to measure the length of the cable or the distance to a fault.



## Functions




The following functions are used by pressing the appropriate soft key or button.

- **Favorites**  - activates favorites screen to select or bookmark cable types and VOPs.
- **Calibration**  - activates calibration to calculate VOP for existing cable.
- **System options**  - access system options such as length units (feet or meters).
- **Left/Right Arrow Buttons**  - press to select cable type.
- **Up/Down Arrow Buttons**  - press to adjust VOP value.
- **Back**  - exit length mode and return to main screen.

- The left/right cursor buttons scroll through preset cable types and VOP values (as well as values you may have saved). This list includes generic names (Custom Cable 1, for example) used to save custom VOP values.
- When performing a test, the valid length indicator (=) appears on the top left portion of the screen. This shows that the displayed length is based on a current cable type and VOP. The indicator is removed if the cable type and/or VOP have changed until another test has been performed.

## Changing VOP Values

In the fault location mode, you can adjust the velocity of propagation (VOP) value for any cable and save your adjustment.



- Check to see if your Power Prowler is in the correct Leader/No Leader setting (see system settings page 9).
- Press the **Up/Down** buttons to change the VOP. The digits that are changed will be displayed in grey. Hold the button down to repeat/scroll.
- A red **Edit** label appears on the screen when the first up/down button is pressed.
- Press the **Test** button  to measure the cable with the new VOP value.
- Press the **Default** soft key to return to the default VOP for the current cable type.
- Press the **Return** soft key  to exit editing with the current VOP value. This does not update the cable type with the new VOP value.
- Press the **Save** soft key to save your new VOP value for your current cable type and exit editing.
- Press the **Cancel** soft key  to restore the VOP value you had before editing and return to the main Fault Location display screen.

## Calibrating VOP Values


To find the VOP value with a known length of cable:

- Press the **CAL** soft key.
- A red **Calibrate** label appears on the screen.
- Use the **Up/Down** buttons to match the known cable length (hold the cursor key down to rapidly change the length).






- Use the +50 or -50 soft keys to increase or decrease the length by 50 feet (approximately 20 meters).
- When calibrating a known cable under 50ft (15m) accuracy will be low.
- Press the **Test** button to calculate VOP from your known cable length.
- Press the **Save** soft key  to save the results, or to return to the test screen without saving changes  .

## Favorites


The favorites screen is accessible by pressing the **Favorites** soft key . A table will appear with six user-selected cable types.

Favorites	
1 - 83.8	RG59 Coax
2 - 73.2	12/2 Romex Uncoiled
3 - 60.4	18/4 Fire PLN
4 - 65.2	CAT5E STP
5 - 84.6	Custom Cable 1
6 -	





RG6 Quad Shield

+			
---	---	---	---

### To select a Favorite cable type:


- Press the **Up/Down** buttons to scroll and highlight a cable type in the list.
- Press the **Enter** button  to select the highlighted cable type as the current cable type and return to the Fault Location screen.

### To edit the favorites list:

- Press the **Favorites** soft key .
- Select one of the 6 locations on the table using the **Up/Down** buttons to highlight a desired row in the table.
- Use **Left/Right** buttons to locate a cable type to store in the highlighted row of favorites or press the + soft key to add the current cable type to the selected favorites slot. Press the **Trash Can** soft key  to clear the highlighted row.
- The table contents are bookmarks to cable types (if you change the VOP for a cable type, the table is updated automatically).
- Press the **Save** soft key  to save your changes.
- Press the **Cancel** soft key  to discard changes and exit.

## Conducting a Test

Once your VOP and cable type have been selected, you can run a test.

- Press the green **Test** button  to run a Fault Location test.
- The graphic on the left side of the screen will display an open or short condition.




Open







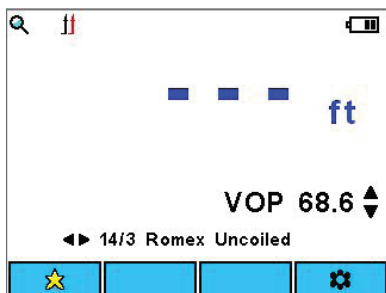

Short


## LIVE EVENT DETECTION



Live Event Detection monitors a cable for changes. In this mode, the Power Prowler detects, locates, and time stamps the fault.

### How to run a Live Event Detection Test

- Press the red **Power** button  to turn the unit on.
- Connect the proper adapter for your application to the Power Prowler, and then connect to the cable under test. Use the **right arrow** button  to scroll to the Live Event Detection icon then press the **Enter** button  or you can press the **Live Event Detection** soft key .
- Use the **Left/Right** buttons  to select the cable type or edit the VOP (as described in Fault Location, on page 15). When editing the VOP you cannot use the **Test** button to verify the new VOP value.
- Press the **Test** button  to begin testing.

On the lower left side of the screen, a timer will appear displaying elapsed time for the test. The Power Prowler will identify any changes (event) to the cable condition (open or short condition). The test will stop when a change is detected or if the cancel soft key is pressed .

## MAINTENANCE

### Batteries

- The Power Prowler is powered by 6 alkaline AA batteries.
- When the battery life indicator is flashing, or the onscreen battery life indicator shows only one bar, it's time to replace the batteries.
  - Make sure the Power Prowler is turned OFF.
  - Using a Philips head screwdriver, remove the back panel.
  - Take the old batteries out and replace with 6 fresh AA batteries.
  - DISPOSAL: Batteries are considered hazardous waste. Dispose of them at a hazardous waste facility.

### Cleaning

- Use a clean, damp cloth to clean the Power Prowler.
- Before cleaning, disconnect all cables from the Power Prowler. Failing to disconnect cables can damage the device and cause personal injury.
- Do not use harsh cleaners, abrasives, or solvents.

### Storage

- When not in use, store the Power Prowler in a dry, protective case. Batteries should be removed if the device is stored for a long time.
- Do not expose the Power Prowler to high temperatures (above 80°C) or humidity. See the specifications section for temperature limits.

## CUSTOMER SERVICE

### Contacting T3 Innovation

For technical information, visit [www.t3innovation.com](http://www.t3innovation.com). For customer service, email [support@t3innovation.com](mailto:support@t3innovation.com).

**Contact Numbers:** Phone: 805-233-3390  
Fax: 805-383-4507

**Address:** 808 Calle Plano  
Camarillo, CA 93012  
USA

## SPECIFICATIONS

<b>Measurement Technology</b>	Spread Spectrum Time Domain Reflectometry U.S. Patents and Patents Pending		
<b>Multimeter Section</b>			
<b>Description</b>	Range	Resolution	Accuracy (% + counts)
<b>DC Volts</b>	600V	1V	±(0.5% + 2)
	400.0V	0.1V	
	40.00V	0.01V	
	4.000V	0.001V	
<b>Auto-ACV LoZ True-rms</b>	600V	0.1V	±(2.0% + 3) DC, 45~500 Hz ±(4.0% + 3) DC, 500~1 KHz
<b>AC Volts True-rms</b>	600V	0.1V	±(1.0% + 3) DC, 45~500 Hz ±(2.0% + 3) DC, 500~1 KHz
<b>Ohms</b>	400.0 KΩ	0.1 Ω	±(0.9% + 2)
	4.000 KΩ	0.001 KΩ	±(0.9% + 2)
	40.00 KΩ	0.01 KΩ	±(0.9% + 2)
	400.0 KΩ	0.1 MΩ	±(0.9% + 2)
	4.000 MΩ	0.001 MΩ	±(0.9% + 2)
<b>Languages</b>	ENGLISH, FRENCH, SPANISH		
<b>Power</b>	6x AA alkaline batteries, typical battery current: Off mode - 4.25 uA Multimeter mode: 81 mA with backlight, 41 mA dim backlight Fault Location: 82mA - one test per minute with backlight Live Event Detection: 115 mA when active with backlight, 75 mA dim backlight		
<b>Battery Life</b>	6 x AA alkaline batteries Standby: life of the battery Operating: 20 to 30 hours, mode dependent Batteries are included		
<b>Maximum Range</b>	12,000 ft (3,657 m) at .999 VOP VOP (%) with 3 digit precision ranging from 20.0% to 99.9%		
<b>Output Connector</b>	Banana Jacks 600V CAT III		
<b>Leader Cable</b>	Cable Assembly, 5 ft. (1.5 m) 600 Volt CAT III, 95 Ohm		

<b>Altitude</b>	6,500 ft (2,000m) operating
<b>Temperature</b>	Operating: 14 to 122°F (-10 to 50°C); Storage: -4 to +140°F (-20 to 60°C)
<b>Humidity</b>	10 to 90% non-condensing
<b>Enclosure</b>	High-strength PC/ABS plastic with V0 rating with boot
<b>Size</b>	1.85"H x 3.6"W x 6.8"L (4.7 x 9.15 x 17.3 cm)
<b>Weight</b>	With batteries: 1 lb 2 oz (510 g)
<b>Safety Compliances</b>	Complies with ANSI/ISA 82.02.01 (61010-1) 2004, CAN/ CSA-C22.2 No 61010-1-04, UL 6101B (2003) and IEC/EN 61010-1 2nd Edition for measurement Category III, 600 V, EMC EN61326-1
<b>Warranty</b>	1 Year



## **PATENTS/INTELLECTUAL PROPERTY**

T3 Innovation product: Power Prowler may be covered by one or more of the following patents: US Patent No. 6868357, US Patent No. 6937944, US Patent No. 7069163, US Patent No. 7215126, US Patent No. 7250772, US Patent No. 7271596, US Patent No. 7165200, US Patent No. 7495450, US Patent No. 7075309, US Patent No. 7282922, US Patent No. 7634012, US Patent No. 7622931, US Patent No. 7548071.

## Warranty Information

T3 Innovation guarantees that its products will be free of all defects in material and workmanship. This warranty extends for a period of 12 months for the T3 Innovation test equipment from the date of manufacture or proof-of-purchase.

All products deemed defective under this warranty will be repaired or replaced at T3 Innovation's discretion. No further warranties either implied or expressed will apply, nor will responsibility for operation of this device be assumed by T3 Innovation.

## Product Registration

Registering your Power Prowler allows you to access support information and receive product updates. Register your products on the T3 Innovation website: [www.t3innovation.com/warranty](http://www.t3innovation.com/warranty).

## Disposal



WEEE Compliant: Prior to disposal of this product, please contact T3 Innovation for proper disposal options.

## Returns

Prior to returning any product to T3 Innovation, you must first request a Return Merchandise Authorization Number by contacting the Customer Service Department at 805-233-3390 or by emailing [support@t3innovation.com](mailto:support@t3innovation.com).

**Note:** *Shipments will not be accepted without this number, which must be clearly marked on the shipping label.*

1. Prior to packing, include a copy of the sales receipt if available. Otherwise the date of manufacturer will be used to calculate warranty date.
2. Provide a description of the operational problem with the product(s) being returned.
3. Include a contact name, phone number, and e-mail address.
4. Pack items securely to prevent damage during shipping.
5. Ship prepaid to:  
T3 Innovation  
808 Calle Plano  
Camarillo, CA 93012  
USA

***Power Prowler™***

# *Power Prowler*<sup>™</sup>

The 21st Century Dual Mode TDR for Testing and  
Monitoring Energized and Unenergized Cables

## **User Manual**



For technical information and customer support,  
please visit [www.t3innovation.com](http://www.t3innovation.com) or send an  
email to [support@t3innovation.com](mailto:support@t3innovation.com).

**Contact Numbers:** Phone: 805-233-3390  
Fax: 805-383-4507

**Address:** 808 Calle Plano  
Camarillo, CA 93012  
USA

[www.t3innovation.com](http://www.t3innovation.com)